


MicroPlumb® MCR 4001/4003 SERIES CONTROLLER INSTALLATION INSTRUCTIONS

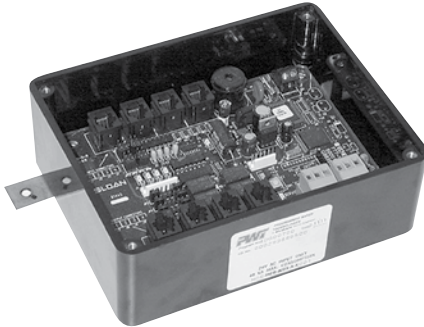

Installation of the PWT MICROPlumb MCR 4001/4003 Series Controller incorporates the latest advances in microprocessor technology to provide maximum control of your plumbing system. MICROPlumb patented sensing and metering products can be programmed to do just about anything you require, when you require it, including the ability to Delay and Lock-Out fixture activation. MICROPlumb products control showers, water closets, lavatory and combination fixtures and help maintain operation of ON/OFF/DELAY. These modular, flexible systems for new retrofit or expansion applications, have few moving parts, no mechanical metering devices, and operate on low voltage to ensure safety and reliability. The following instructions will serve as a guide when installing the MCR 4001/4003 Series Controller. As always, good safety practices and care are recommended when installing your new controller. If further assistance is required contact your nearest Sloan PWT Representative office.

LIMITED WARRANTY

Unless otherwise noted, Sloan Valve Company warrants this product, manufactured and sold for commercial or industrial uses, to be free from defects in material and workmanship for a period of three (3) years (one (1) year for special finishes, SF faucets, PWT electronics and 30 days for PWT software) from date of first purchase. During this period, Sloan Valve Company will, at its option, repair, replace, or refund the purchase price of any product which fails to conform with this warranty under normal use and service. This shall be the sole and exclusive remedy under this warranty. Products must be returned to Sloan Valve Company, at customer's cost. No claims will be allowed for labor, transportation or other costs. This warranty extends only to persons or organizations who purchase Sloan Valve Company's products directly from Sloan Valve Company for purpose of resale. This warranty does not cover the life of the batteries.

THERE ARE NO WARRANTIES WHICH EXTEND BEYOND THE DESCRIPTION ON THE FACE HEREOF. IN NO EVENT IS SLOAN VALVE COMPANY RESPONSIBLE FOR ANY CONSEQUENTIAL DAMAGES OF ANY MEASURE WHATSOEVER.

PRIOR TO INSTALLATION

Before you install the MCR series flushometer, be sure the items listed below are installed.

- 24 VAC step down transformer
- Push buttons
- Flushometer
- Lavatory/Shower solenoids


IMPORTANT:

- **ALL PLUMBING SHOULD BE INSTALLED IN ACCORDANCE WITH APPLICABLE CODES AND REGULATIONS.**
- **WATER SUPPLY LINES MUST BE SIZED TO PROVIDE AN ADEQUATE VOLUME OF WATER FOR EACH FIXTURE.**
- **FLUSH ALL WATER LINES PRIOR TO MAKING CONNECTIONS.**
- **ALL ELECTRICAL WIRING IS TO BE INSTALLED IN ACCORDANCE WITH NATIONAL/LOCAL CODES AND REGULATIONS.**

1 - MOUNTING CONTROLLER


- A. Remove plastic cover from front of controller.
- B. Install controller so that all cables for solenoids enter from the bottom and all cables from pushbuttons enter at top. Controller must be located within 15 ft from furthest pushbutton and within 200 ft of power supply transformer.
- C. Mount controller to wall using mounting screws and plastic anchors.

NOTE: Extension cables are available as an option from PWT to allow for installing the controller up to 35 ft from furthest push button.



2 - POWER SUPPLY CONNECTION


- A. Make sure power is off to 24 VAC transformer.
- B. Run 18-gauge wire from secondary side (24 VAC output) of transformer to terminal block inside controller.
- C. Turn power on and look for power indicator to illuminate.
- D. Turn power off until pushbuttons and solenoids are installed.

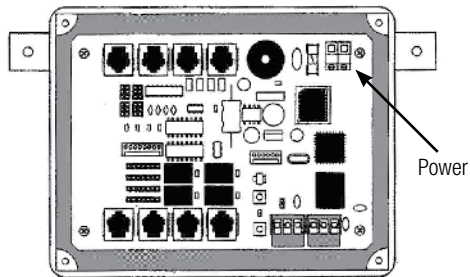

IMPORTANT: BE SURE THAT WIRE IS COMPLETELY INSERTED INTO TERMINAL AND THAT NO STRANDS ARE CROSSING FROM ONE SIDE TO THE OTHER.

3 - PUSH BUTTONS AND SOLENOID CONNECTIONS

- A. Plug RJ-II connectors from push buttons into appropriate input connections in controller. Refer to program type section of these instructions.
- B. Plug RJ-II connectors from flushometers, lavatories and/or shower solenoids into appropriate output connections in controller. Refer to program type section of these instructions.
- C. Power up controller.

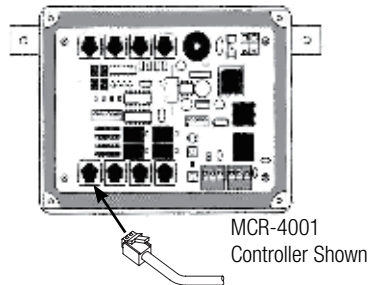


IMPORTANT: MAKE SURE THAT ALL PUSH BUTTONS ARE CONNECTED TO THE INPUT AND SOLENOIDS CONNECTED TO THE OUTPUT. IMPROPER CONNECTIONS WILL RESULT IN FAILURE OF CONTROLLER AND/OR PUSH BUTTONS AND SOLENOIDS AND WILL REQUIRE REPLACEMENT.

4 - NETWORK CONNECTIONS


- A. Remove the female ends of the two green terminal connections from controller.
- B. Take the incoming network twisted pair wire and insert one wire into position 1 and 2 of the female terminal ends and tighten screw.
- C. Plug male terminal into either of the female connections on controller.
- D. Take outgoing network twisted pair wire and repeat steps 2 and 3.

NOTE: Refer to communication network installation for detailed wiring.

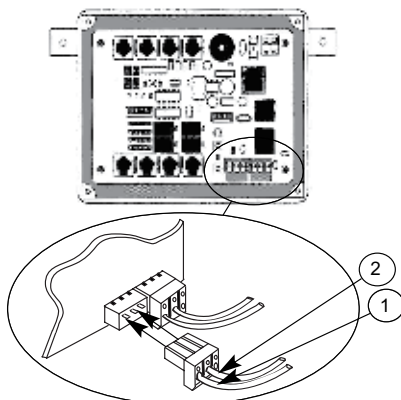

5 - TEST CONTROLLER

- A. Activate push buttons one at a time to test for correct wiring of controller. Use push button and solenoid LEDs to confirm proper push button and solenoid locations.
- B. Test communications (if applicable) from computer using PWT Network Manager software.
- C. Reinstall cover.

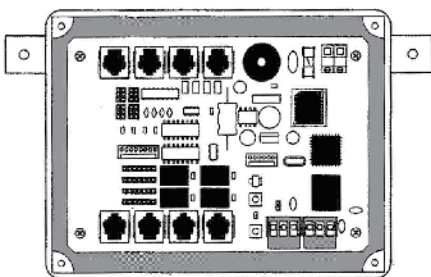

TYPE DESCRIPTION

Water Closet Type A

When the water closet push button is pressed, a signal is transmitted to the control board requesting a flush. If the request is valid, the flush cycle is started. There will be a random 1 - 60 second delay before a flush, the flush occurs, and then a a -60 second delay after the flush. If three flush cycle attempts are made within five minutes of the first flush cycle, the flushometer will "Lock Out" for a period of 30 minutes. During this time the "Service" LED will blink 'ON' and 'OFF' at ten second intervals, signaling a violation of the flushometer. When the "LOCK OUT" time expires, the "Service" LED will turn 'OFF' and the flushometer will return to normal operation.

Water Closet Type B

When the water closet push button is pressed, a signal is transmitted to the control board requesting a flush. If the request is valid, the flush cycle is started. There will be a random 1 - 60 second delay before a flush, the flush occurs, and then a 0- 60 second delay after the flush. If three flush cycle attempts are made within five minutes of the first flush cycle, the flushometer will "Lock Out" for a period of 60 minutes. During this time the "Service" LED will blink 'ON' and 'OFF' at ten second intervals, signaling a violation of the flushometer. When the "Lock Out" time expires, the "Service" LED will turn 'OFF' and the flushometer will return to normal operation.

Hot Water Type A

When the hot water push button is pressed, the hot water solenoid will activate for 10 seconds. If the hot water push button is activated a second time within the 10 seconds, the hot water will turn off. Repeated operations are unlimited.

TYPE DESCRIPTION (CONTINUED)

Hot Water Type B

When the hot water push button is pressed, the hot water solenoid will activate for 20 seconds. If the hot water push button is activated a second time within the 20 seconds, the hot water will turn off. Repeated operations are unlimited.

Cold Water Type A

When the cold water push button is pressed, the cold water solenoid will activate for 10 seconds. If the cold water push button is activated a second time within the 10 seconds, the cold water will turn off. Repeated operations are unlimited.

Cold Water Type B

When the cold water push button is pressed, the cold water solenoid will activate for 20 seconds. If the cold water push button is activated a second time within the 20 seconds, the cold water will turn off. Repeated operations are unlimited.

Shower Type A

When the shower push button is pressed, the shower solenoid will activate for 5 minutes. If the shower pushbutton is activated a second time within the 5 minutes, the shower will turn off. A lockout of 20 seconds will occur after the shut off.

Shower Type B

When the shower push button is pressed, the shower solenoid will activate for 3 minutes. If the shower pushbutton is activated a second time within the 3 minutes, the shower will turn off. A lockout of 20 seconds will occur after the shut off.


Shower Type C

The first time the shower push button is pressed, the shower solenoid will activate for 30 seconds. If the shower pushbutton is activated a second time within the 30 seconds, the shower will turn off. A minimum 30-second delay will occur before the next activation. The second activation will activate the shower solenoid for 60 seconds (this is to be 200% of the first activation run time). A lockout of 120 seconds will occur after the second activation.

Shower Type D

The first time the shower push button is pressed, the shower solenoid will activate for 60 seconds. If the shower pushbutton is activated a second time within the 60 seconds, the shower will turn off. A minimum 30-second delay will occur before the next activation. The second activation will activate the shower solenoid for 120 seconds (this is to be 200% of the first activation run time). A lockout of 120 seconds will occur after the second activation.

PROGRAM TYPE SECTION

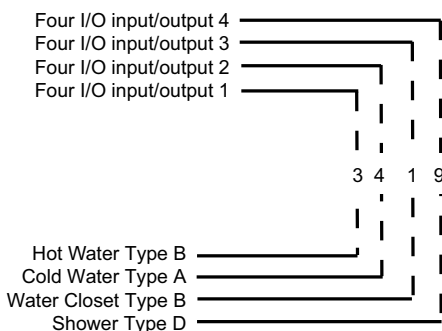

This section outlines how to read and determine a type number for a four I/O control board module.

**When assistance is required, please contact Sloan Technical Support at:
1-888-SLOAN-14 (1-888-756-2614)**

Headquarters

10500 Seymour Avenue
Franklin Park, IL 60131
P: 847-671-4300 / 800-9-VALVE-9
F: 847-671-4380 / 800-447-8329
www.sloanvalve.com